


**AYLESBURY KB TYPE
DIMENSIONS – FRONT VIEW**
SIZES (DN): 3/4"(20), 1"(25), 1 1/4"(32), 1 1/2"(40)SF,
1 1/2"(40)HF, 2"(50)SF

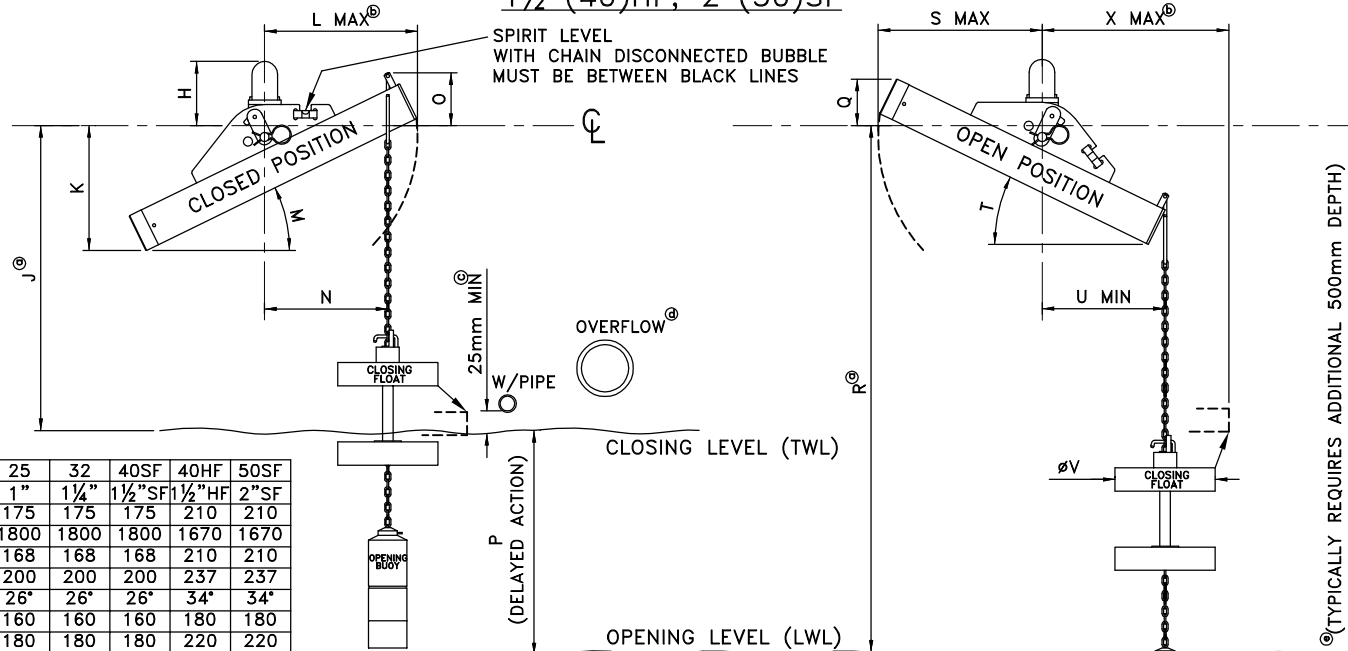

DN	20	25	32	40SF	40HF	50SF
SIZE	3/4"	1"	1 1/4"	1 1/2"SF	1 1/2"HF	2"SF
J _{MIN}	175	175	175	175	210	210
J _{MAX}	1800	1800	1800	1800	1670	1670
K	168	168	168	168	210	210
L _{MAX}	200	200	200	200	237	237
M	26°	26°	26°	26°	34°	34°
N _{MIN}	160	160	160	160	180	180
N _{MAX}	180	180	180	180	220	220
O	70	70	70	70	115	115
P _{MIN}	200	200	200	200	330	330
P _{MAX}	1825	1825	1825	1825	1815	1815
Q	65	65	65	65	120	120
R _{MIN}	375	375	375	375	540	540
R _{MAX}	2000	2000	2000	2000	2000	2000
S _{MAX}	215	215	215	215	268	268
T	26°	26°	26°	26°	34°	34°
U _{MIN}	160	160	160	160	180	180
ØV	130	130	130	130	170	170
W _{MIN}	170	170	170	170	320	320
X _{MAX}	245	245	245	245	305	305
Y _{MIN}	500	500	500	500	800	800

NOTES

- Ⓐ Longer chain available upon request
- Ⓑ Opposite hand valves available as cost option (chain on left)
- Ⓒ SCHED 2, SECT 7, G16.5 Water Regs. Gap should be more if water is turbulent – especially if near valve discharge. 40mm minimum for valves 1 1/2"(DN 40mm) or larger – recommended by Keraflo.
- Ⓓ Typically twice inlet bore. SCHED 2, SECT 7, G16.10 Water Regs. – warning/overflow pipe(s) should be capable of taking any possible flow in the pipe arising from inlet valve failure.
- Ⓔ When opening level = R_{MIN}

See Ki014* for side view
All dimensions in mm unless stated.
Measurements are subject to specific gravity of solution.
Keraflo Ltd reserve the right to change specifications, design and materials without prior notice.



KERAFLO LTD
UNIT 1 WOODLEY PARK EST.
59-69 READING ROAD
WOODLEY, READING
BERKSHIRE, RG5 3AN, UK
TEL: +44 (0)118 921 9920
FAX: +44 (0)118 921 9921
e-mail: info@keraflo.co.uk
web site: www.keraflo.co.uk

Ki010K
27/11/07