


## KP TYPE FLOAT VALVE KIT FOR TWIN/PARTITIONED TANKS IN RAISED CHAMBER WITH SLOT WEIR AND TYPE AB AIR GAP

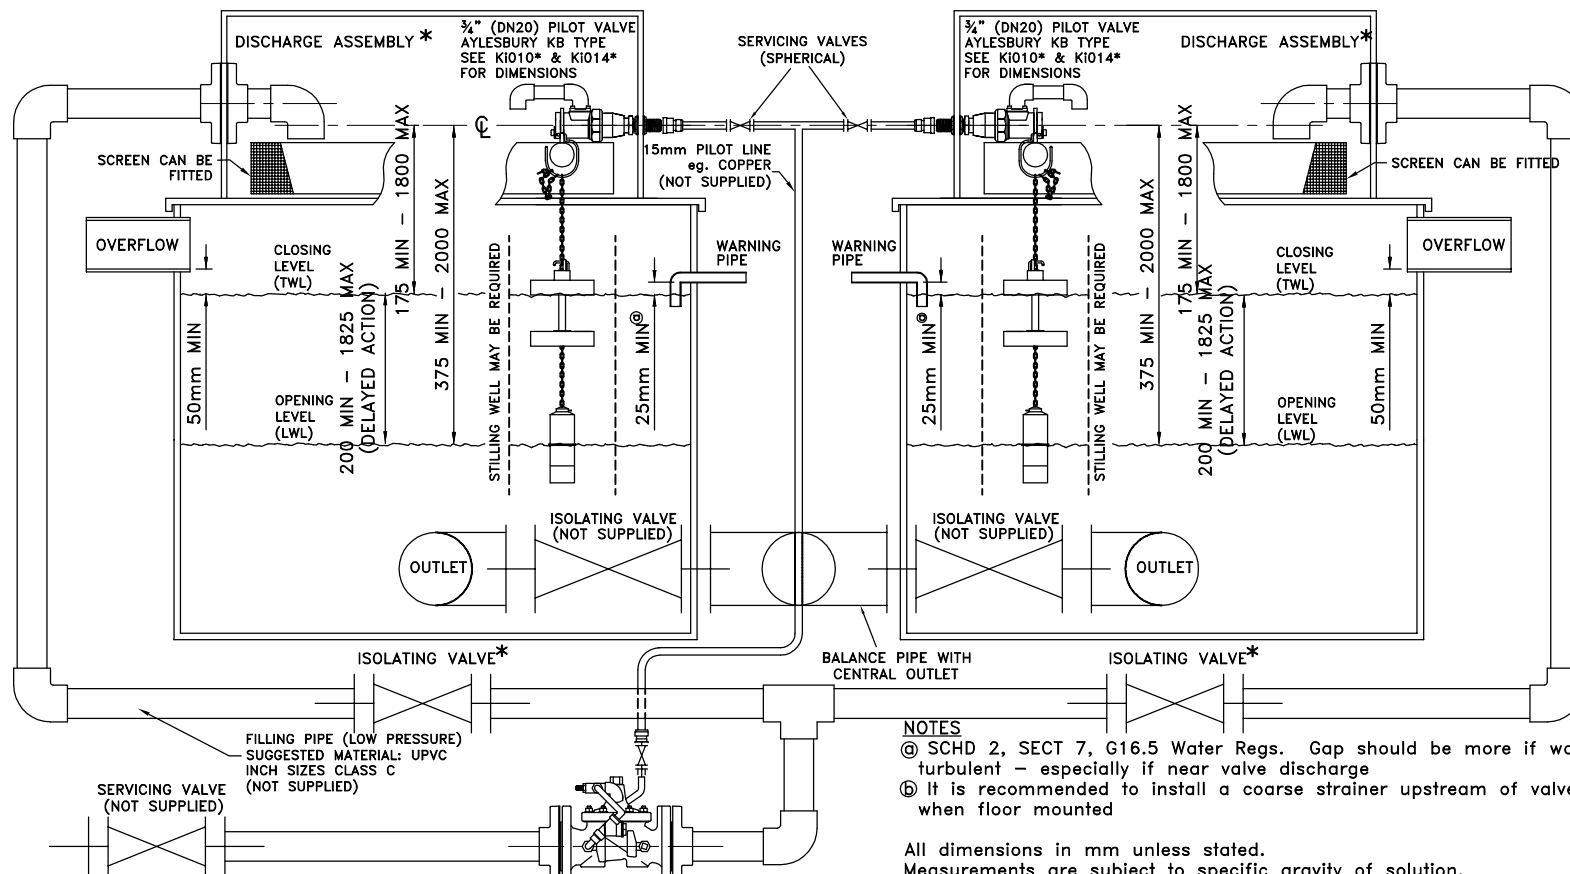

**NOTES**

- Ⓒ SCHD 2, SECT 7, G16.5 Water Regs. Gap should be more if water is turbulent - especially if near valve discharge
- Ⓓ It is recommended to install a coarse strainer upstream of valve when floor mounted

All dimensions in mm unless stated.  
Measurements are subject to specific gravity of solution.  
Keraflo Ltd reserve the right to change specifications, design and materials without prior notice.

VALVE	* PIPEWORK SIZE
1 1/2"	1"
2"	1 1/2"
2 1/2"	2"
3"	2"
4"	3"
6"	4"
8"	6"

FLOOR MOUNTED SHOWN Ⓒ  
(SEE DESIGN & PRE-INSTALLATION INFORMATION FOR OTHER OPTIONS)

This configuration enables one control valve to fill two tanks. When either (or both) Pilot Valve is open, the Control Valve feeds each tank equally. During maintenance - one tank can be isolated whilst the other remains operational.



KERAFLO LTD  
UNIT 1 WOODLEY PARK EST.  
59-69 READING ROAD  
WOODLEY, READING  
BERKSHIRE, RG5 3AN, UK  
TEL: +44 (0)118 921 9920  
FAX: +44 (0)118 921 9921  
e-mail: info@keraflo.co.uk  
web site: www.kerflo.co.uk

K1039F  
02/06/07